

**Optimum Short-Term Hydrothermal  
Scheduling with Spinning Reserve  
through Network Flows.**

F.J. Heredia & N. Nabona

Statistics and Operations Research Dept.  
Universitat Politècnica de Catalunya

New York. February 95

---

**INDEX**


- Description of the problem.
  - Formulation of the mathematical model.
  - Solution Method.
  - Computational Results.
  - Conclusions.
-

## **DESCRIPTION OF THE PROBLEM**

- **Given :**
  - \* A hydro system with  $N_r$  reservoirs.
  - \* A thermal system with  $N_u$  thermal units.
  - \* A set of  $N_l$  load nodes.
  - \* A transmission network.
- **find, for each time interval of the period studied:**
  - \* The reservoir discharges and storages.
  - \* The thermal unit power output.
  - \* The power flows on the transmission network.
- **such that minimize:**
  - \* The thermal generation cost.
  - \* The losses on the transmission network.
- **satisfying:**
  - \* The forecasted load requirements.
  - \* The spinning reserve requirements.
  - \* The KCL and KVL in the transmission network.

---

**HYDRO NETWORK**

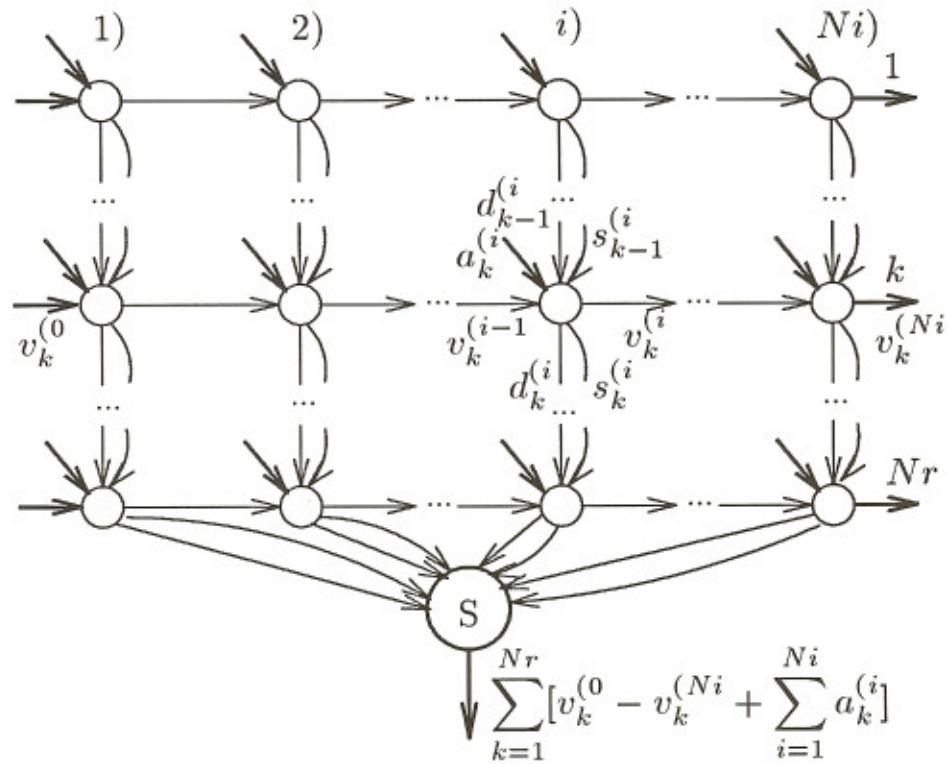

- Balance equation at reservoir  $k$  over interval  $i$ :

$$a_k^{(i)} + v_k^{(i-1)} + d_{k-1}^{(i)} + s_{k-1}^{(i)} = v_k^{(i)} + d_k^{(i)} + s_k^{(i)} \quad (1)$$

(delays and pumping are considered but not depicted here)

---

## HYDROGENERATION FUNCTION

- Hydrogeneration at reservoir  $k$  over interval  $i$  :

$$H_k^{(i)} = \mu \rho_k {}^i h_k {}^i d_k {}^i \quad (2)$$

- \* Reservoir head function :

$$h_k = s_{bk} + s_{lk} v_k + s_{qk} v_k^2 + s_{ck} v_k^3 \quad (3)$$

- \* Efficiency :

$$\begin{aligned} \rho_k^{(i)} = & \rho_{k0} + \rho_{kh} h_k^{(i)} + \rho_{kdd} d_k^{(i)} + \\ & + \rho_{khd} h_k^{(i)} d_k^{(i)} + \rho_{khh} (h_k^{(i)})^2 + \rho_{kdd} (d_k^{(i)})^2 \end{aligned} \quad (4)$$

- Total hydrogeneration over interval  $i$  :

$$H^{(i)} = \sum_{k=1}^{Nr} H_k^{(i)} \quad (5)$$

- Hydrogeneration linearization :

$$H_k^{(i)} \approx H_{Lk}^{(i)} = \lambda_{0k}^{(i)} + \lambda_{v(i-1)k}^{(i)} v_k^{(i-1)} + \lambda_{v(i)k}^{(i)} v_k^{(i)} + \lambda_{dk}^{(i)} d_k^{(i)} \quad (6)$$


## THERMAL SYSTEM MODELIZATION

- Variables associated to the generation of a single unit:

$$\underline{P}_j \leq P_j \leq \overline{P}_j \quad (7)$$

$$r_{Ij} = \min\{\bar{r}_{Ij}, \overline{P}_j - P_j\} \quad (8)$$

$$r_{Dj} = \min\{\bar{r}_{Dj}, P_j - \underline{P}_j\} \quad (9)$$

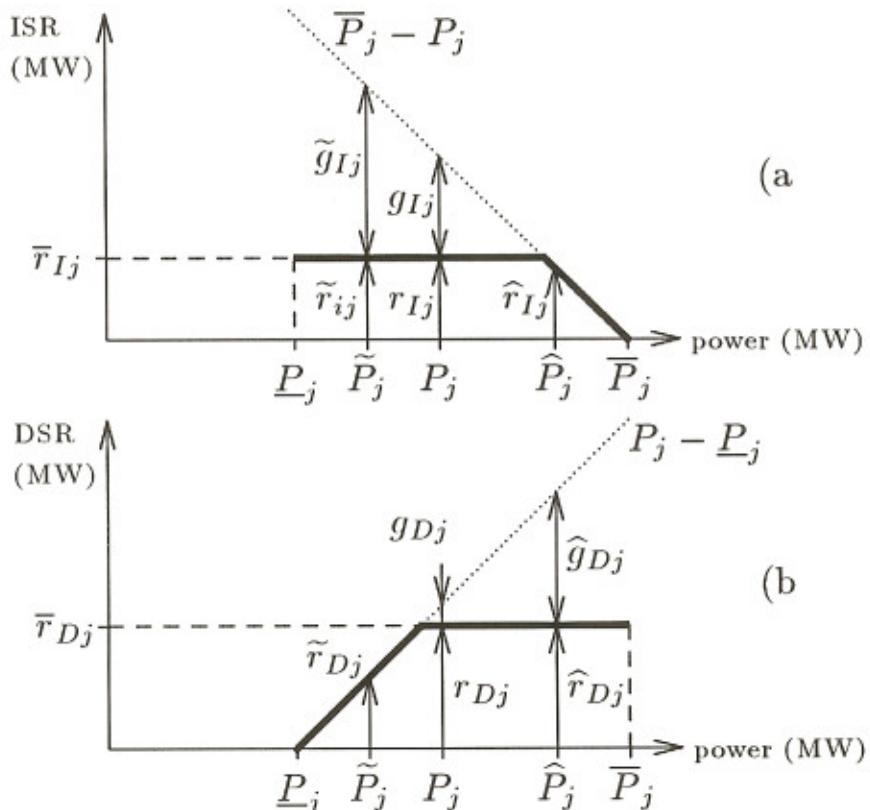


**EQUIVALENT THERMAL NETWORK UNIT  $j$**

$$r_{Ij} \leq \bar{r}_{Ij} \quad (10)$$

$$r_{Ij} \leq \min\{\bar{r}_{Ij}, \bar{P}_j - P_j\} \begin{cases} r_{Ij} \leq \bar{P}_j - P_j \\ \downarrow \\ r_{Ij} + g_{Ij} = \bar{P}_j - P_j \end{cases} \quad (11)$$

$$r_{Dj} \leq \bar{r}_{Dj} \quad (12)$$


$$r_{Dj} \leq \min\{\bar{r}_{Dj}, P_j - \underline{P}_j\} \begin{cases} r_{Dj} \leq P_j - \underline{P}_j \\ \downarrow \\ r_{Dj} + g_{Dj} = P_j - \underline{P}_j \end{cases} \quad (13)$$

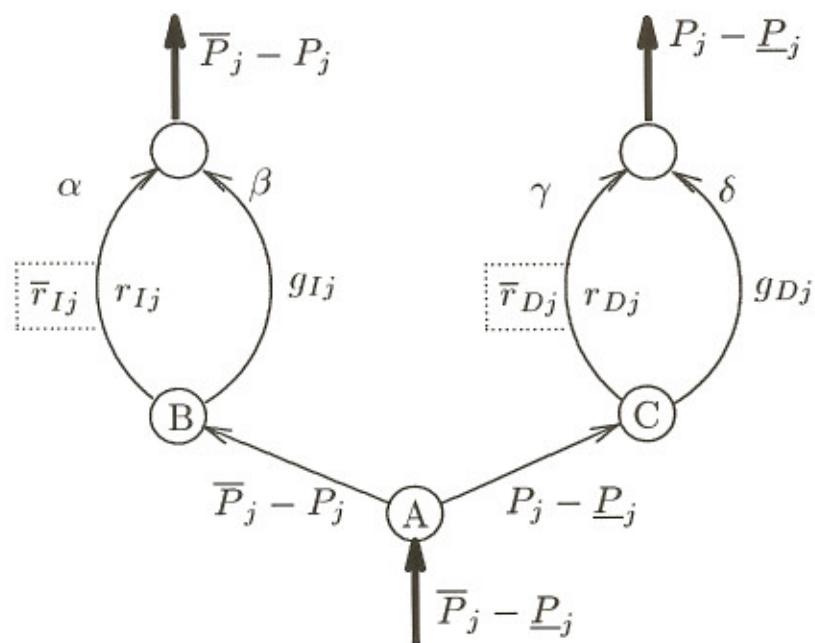

---

**THERMAL SYSTEM NETWORK AT INTERVAL  $i$**

---

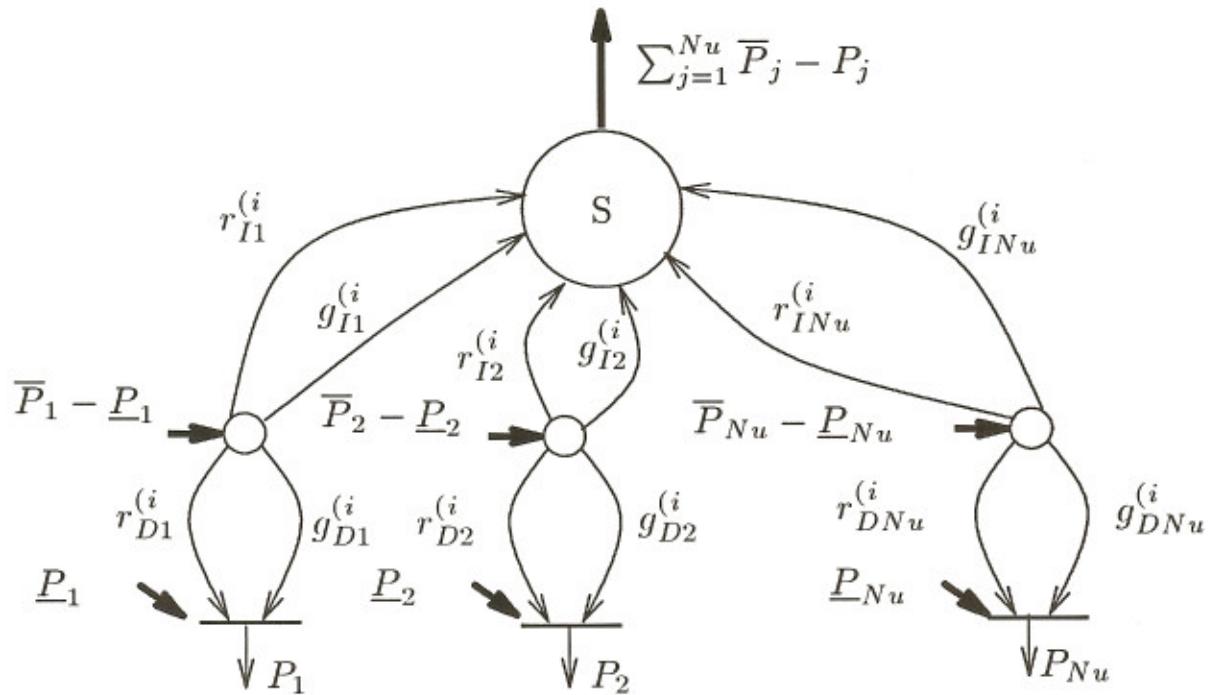

- Balance equations :

$$* \quad \bar{P}_j - \underline{P}_j = r_{Ij}^{(i)} + g_{Ij}^{(i)} + r_{Dj}^{(i)} + g_{Dj}^{(i)} \quad j = 1, \dots, Nu \quad (14)$$

- Thermal generation at interval  $i$ :


$$* \quad P^{(i)} = \sum_{j=1}^{Nu} (r_{Dj}^{(i)} + g_{Dj}^{(i)} + \underline{P}_j) \quad (15)$$

- Spinning reserve at interval  $i$ : (underestimate)

$$* \quad \text{Incremental : } \sum_{j=1}^{Nu} r_{Ij}^{(i)} \quad (16)$$

$$* \quad \text{Decremental : } \sum_{j=1}^{Nu} r_{Dj}^{(i)} \quad (17)$$

## THERMAL + TRANSMISSION NETWORK

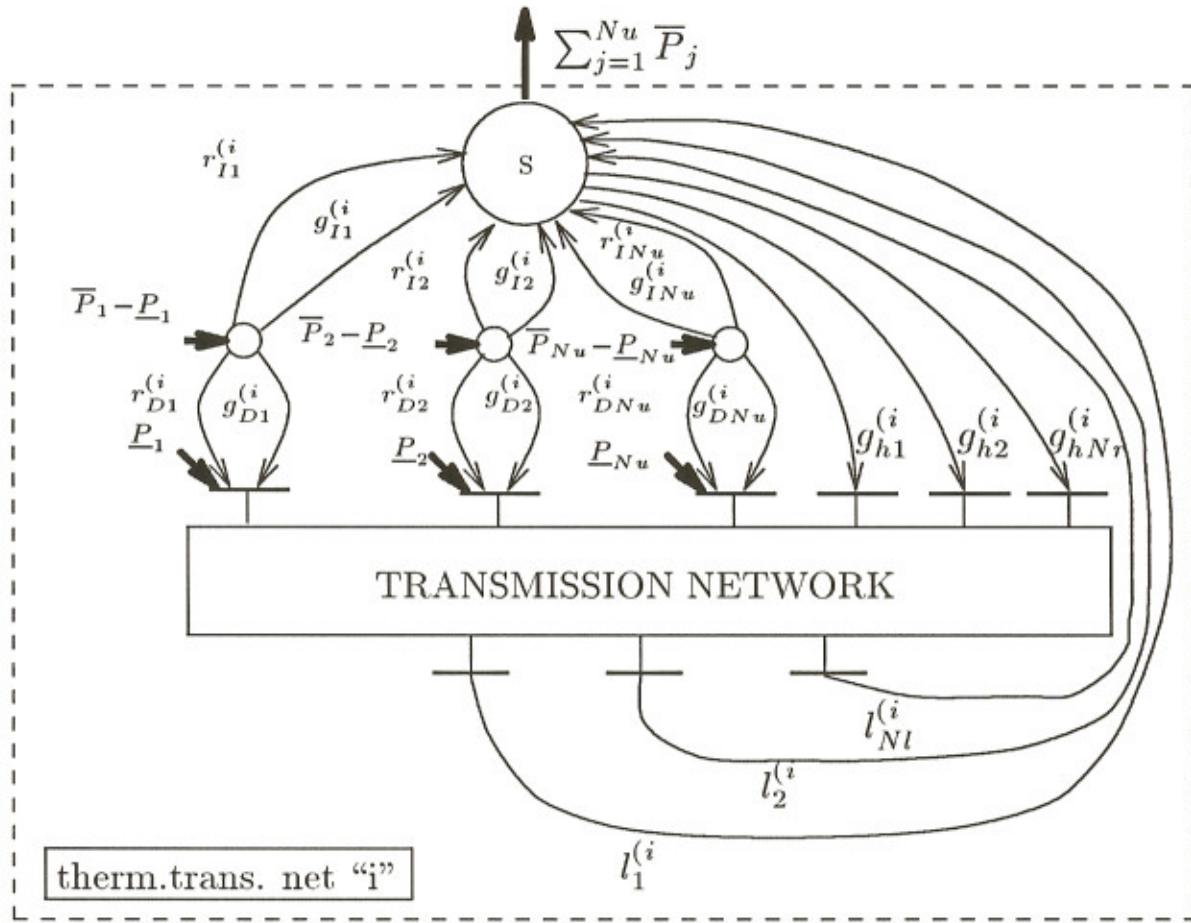


- Hydrogeneration arcs flow equal to the hydrogeneration value :

$$g_{hk}^{(i)} = H_k^{(i)} \approx \lambda_{0k}^{(i)} + \lambda_{v(i-1)k}^{(i)} v_k^{(i-1)} + \lambda_{v(i)k}^{(i)} v_k^{(i)} + \lambda_{dk}^{(i)} d_k^{(i)} \quad k = 1, \dots, Nr \quad (18)$$

- Load arcs :

$$L_l^{(i)} - \epsilon \leq l_l^{(i)} \leq L_l^{(i)} + \epsilon \quad l = 1, \dots, Nl \quad (19)$$

## TRANSMISSION NETWORK AT INTERVAL $i$

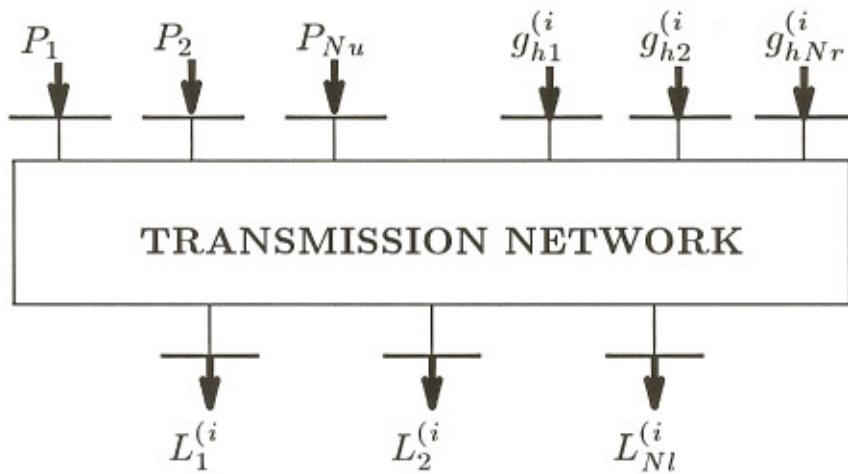

- dc approach considered.
- Line capacity :

$$-\bar{p}_m \leq p_m^{(i)} \leq \bar{p}_m, \quad m = 1, \dots, Nm$$

- Kirchhoff's laws :

\* KCL : balance equations of the transmission network.

\* KVL :


$$\sum_{m \in C_j} X_m p_m^{(i)} = 0 \quad ; \quad j = 1, \dots, Nc \quad (20)$$

$Nc$  : number of basic loops.

$C_j$  : lines belonging to the  $j^{\text{th}}$  basic loop.

$X_j$  : line reactance (p.u.).

**THERMAL NETWORK AT INTERVAL  $i$**   
 (without transmission network)

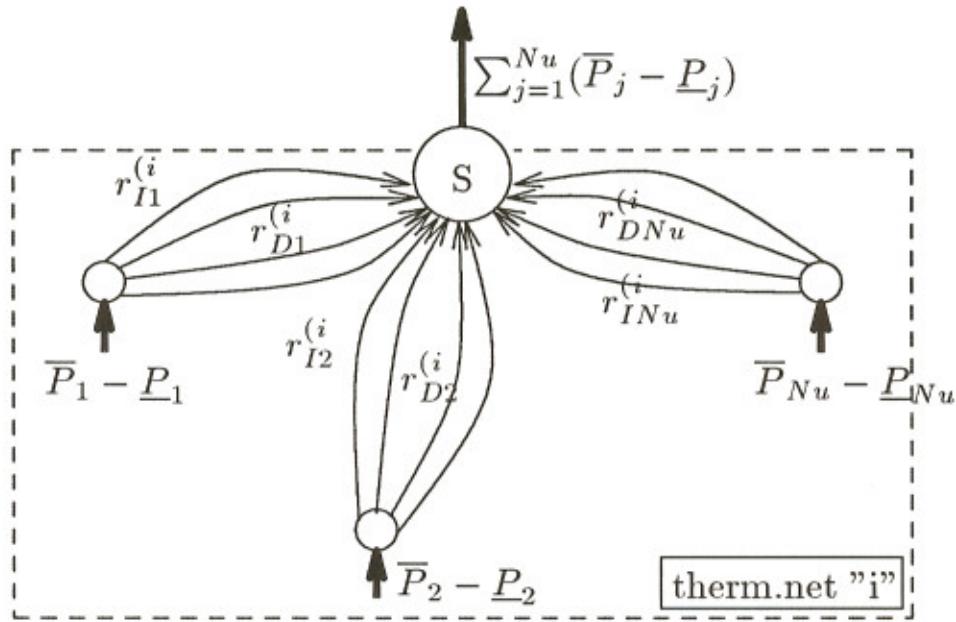


- Load side constraint :

$$\sum_{k=1}^{Nr} H_k^{(i)} + \sum_{j=1}^{N_u} (r_{Dj}^{(i)} + g_{Dj}^{(i)} + P_j) = L^{(i)} \quad (21)$$

- \* If linearized hydrogeneration is considered :

$$\begin{aligned} & \sum_{k=1}^{Nr} \lambda_{0k}^{(i)} + \lambda_{v(i-1)k}^{(i)} v_k^{(i-1)} + \lambda_{v(i)k}^{(i)} v_k^{(i)} + \lambda_{dk}^{(i)} d_k^{(i)} + \\ & + \sum_{j=1}^{N_u} (r_{Dj}^{(i)} + g_{Dj}^{(i)} + P_j) = L^{(i)} \end{aligned} \quad (22)$$

**HYDRO-THER.-TRANS. EXT. NET. (HTTEN)**

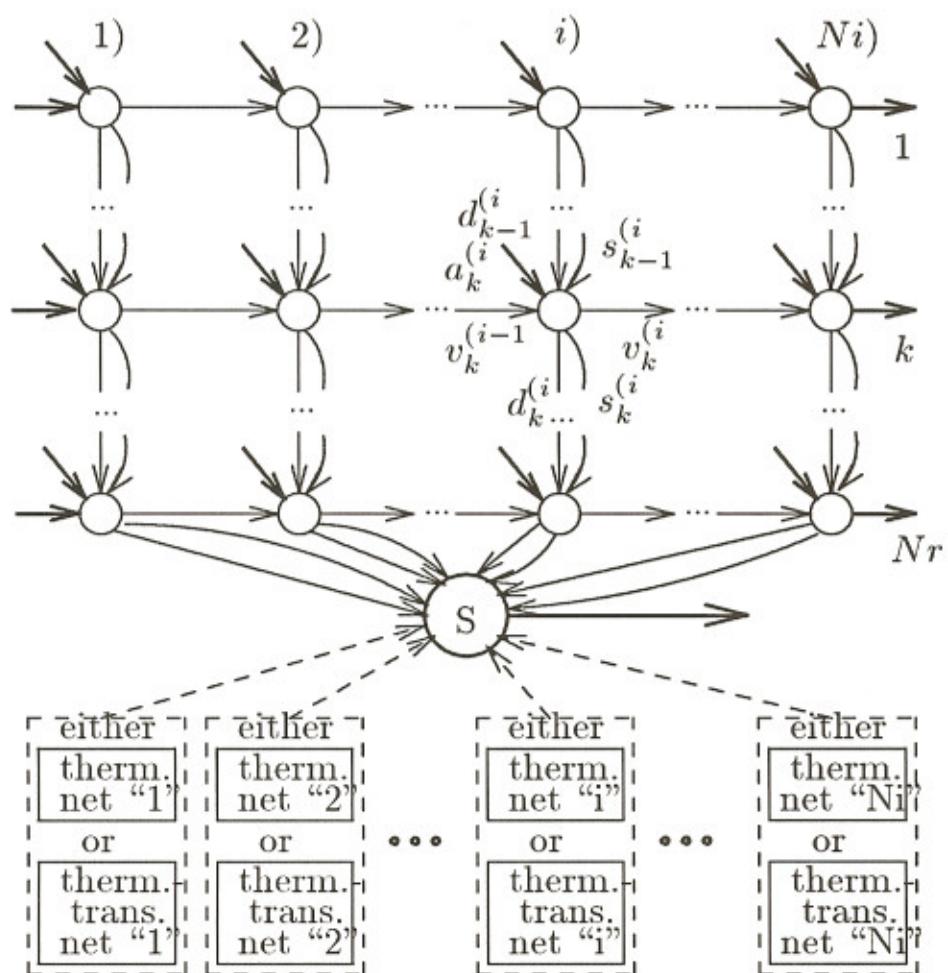

## VARIABLES AND OBJECTIVE FUNCTION

- **Variables :**  $i = 1, \dots, Ni$ 
  - \* Hydro variables :  $d_k^{(i)}, s_k^{(i)}, v_k^{(i)}, k = 1, \dots, Nr$
  - \* Thermal variables :  $r_{Ij}^{(i)}, g_{Ij}^{(i)}, r_{Dj}^{(i)}, g_{Dj}^{(i)}, j = 1, \dots, Nu$
  - \* Transmission variables :  $p_m^{(i)}, m = 1, \dots, Nm$
  - \* Hydrogen. variables :  $g_{hj}^{(i)}, j = 1, \dots, Nr$

- **Objective function : two parts**

- \* Thermal generation costs :

$$\sum_{i=1}^{Ni} \sum_{j=1}^{Nu} [c_{lj}(r_{Dj}^{(i)} + g_{Dj}^{(i)} + \underline{P}_j) + c_{qj}(r_{Dj}^{(i)} + g_{Dj}^{(i)} + \underline{P}_j)^2] \quad (23)$$

- \* Costs of power losses:

$$\sum_{i=1}^{Ni} \pi^{(i)} \sum_{m=1}^{Nm} r_m(p_m^{(i)})^2 \quad (24)$$

$$\begin{aligned} \min \sum_{i=1}^{Ni} \left\{ \sum_{j=1}^{Nu} [c_{lj}(r_{Dj}^{(i)} + g_{Dj}^{(i)} + \underline{P}_j) + c_{qj}(r_{Dj}^{(i)} + g_{Dj}^{(i)} + \underline{P}_j)^2] \right. \\ \left. + \pi^{(i)} \sum_{m=1}^{Nm} r_m(p_m^{(i)})^2 \right\} \quad (25) \end{aligned}$$

## CONSTRAINTS

- Balance equations of th HTTEN.
- Side constraints : for each interval :  $i = 1, \dots, Ni$

\* Hydrogeneration arcs flow equal to the hydrogeneration value :

$$g_{hk}^{(i)} = H_k^{(i)} \approx \lambda_{0k}^{(i)} + \lambda_{v(i-1)k}^{(i)} v_k^{(i-1)} + \lambda_{v(i)k}^{(i)} v_k^{(i)} + \lambda_{dk}^{(i)} d_k^{(i)} \quad k = 1, \dots, Nr \quad (18)$$

\* Incremental spinning reserve :

$$\sum_{k=1}^{Nr} (\bar{H}_k^{(i)} - g_{hk}^{(i)}) + \sum_{j=1}^{Nu} r_{Ij}^{(i)} \geq R_I^{(i)} \quad (26)$$

\* Decremental spinning reserve :

$$\sum_{k=1}^{Nr} g_{hk}^{(i)} + \sum_{j=1}^{Nu} r_{Dj}^{(i)} \geq R_D^{(i)} \quad (27)$$

\* KVL :

$$\sum_{m \in C_j} X_m p_m^{(i)} = 0 \quad ; \quad j = 1, \dots, Nc \quad (20)$$

- Variable bounds.

**OPTIMIZATION PROBLEM**

- Exact hydrogeneration function :

$$(NNNC) \left\{ \begin{array}{ll} \min & f(x) \\ \text{subj. to :} & Ax = r \\ & g(x) + \mathbf{I}_z z = b \\ & 0 \leq x \leq u_x \end{array} \right. \begin{array}{l} (28a) \\ (28b) \\ (28c) \\ (28d) \end{array}$$

- Linearized hydrogeneration function :

$$(NNLC) \left\{ \begin{array}{ll} \min & f(x) \\ \text{subj. to :} & Ax = r \\ & Tx + \mathbf{I}_z z = b \\ & 0 \leq x \leq u_x \end{array} \right. \begin{array}{l} (29a) \\ (29b) \\ (29c) \\ (29d) \end{array}$$

## SOLUTION METHODS

- (NNLC) problem : NOXCB (Heredia & Nabona)
  - \* Specialised code for the nonlinear network flow problem with linear side constraints :
- $$g_{hk}^{(i)} = \lambda_{0k}^{(i)} + \lambda_{v(i-1)k}^{(i)} v_k^{(i-1)} + \lambda_{v(i)k}^{(i)} v_k^{(i)} + \lambda_{dk}^{(i)} d_k^{(i)} \quad (18)$$
- \* Successive linearizations.
  - \* Any other set of linear constraint could be included.
- (NNNC) problem : MINOS (Murtagh & Saunders)
  - \* General purpose nonlinear optimization package :

$$g_{hk}^{(i)} = \mu \rho_k^{(i)} h_k^{(i)} d_k^{(i)}$$

## ITERATIVE SOLUTION METHOD

### 0 Initializations.

**0.1** Definition of the network equations of  $(\text{NNLC})^0$

**0.2** Selection of the initial solution  $[x]^0$  ;  $k := 1$ .

**0.3** Maximum hydrogeneration error :  $\epsilon_L \approx 0.02$

### 1 Major iterations.

**1.4** Linearization about  $[x]^{k-1} \rightarrow (\text{NNLC})^k$ .

**1.5** Optimization of  $(\text{NNLC})^k$  with NOXCB  $\rightarrow [x]^k$

**1.6** If  $|[H_L^{(i)}]^k - [H^{(i)}]^k| < \epsilon_L L^{(i)}$ ,  $\forall i$  then  $x^* := [x]^k$  ; STOP

**1.7**  $k := k + 1$ . go to **1.4** .

---

## COMPUTATIONAL RESULTS

Table I : Case examples

Problem ident.	Power system size					Opt. problem size		
	Nr	Nu	Nm	Nb	Ni	arcs	nodes	S.C.
A24	3	4	-	-	24	648	163	72
A48	3	4	-	-	48	1248	313	144
A168	3	4	-	-	168	4536	1135	504
B48	6	4	-	-	48	1824	457	144
B168	6	4	-	-	168	6552	1639	504
B48x	6	4	6	5	48	2256	697	240
B168x	6	4	6	5	168	8064	2479	840
C48	9	8	19	12	48	4416	1346	528
C168	9	8	19	12	168	15600	4741	1848

Table II : Computational results

Problem ident.	max. gen. err.	no. of linear.	CPU (s) <sup>1</sup>		Cost (10 <sup>6</sup> Pts)	
			NOXCB	MINOS	NOXCB	MINOS
A24	$\leq 0.7\%$	3	14.7	38.7	73.10	73.15
A48	$\leq 1.1\%$	3	39.2	219.6	124.23	124.39
A168	$\leq 1.4\%$	3	623.5	6530.7	361.82	362.16
B48	$\leq 0.9\%$	3	31.2	514.3	123.07	123.19
B168	$\leq 1.5\%$	2	336.2	6667.8	361.30	361.62
B48x	$\leq 1.3\%$	3	49.5	394.1	132.15	132.34
B168x	$\leq 1.4\%$	2	538.4	4963.2	384.40	384.54
C48	$\leq 1.5\%$	2	337.6	6020.1	199.32	199.47
C168	$\leq 1.7\%$	2	2982.47	-	538.73	-

<sup>1</sup> SUN SparcStation 10/41.

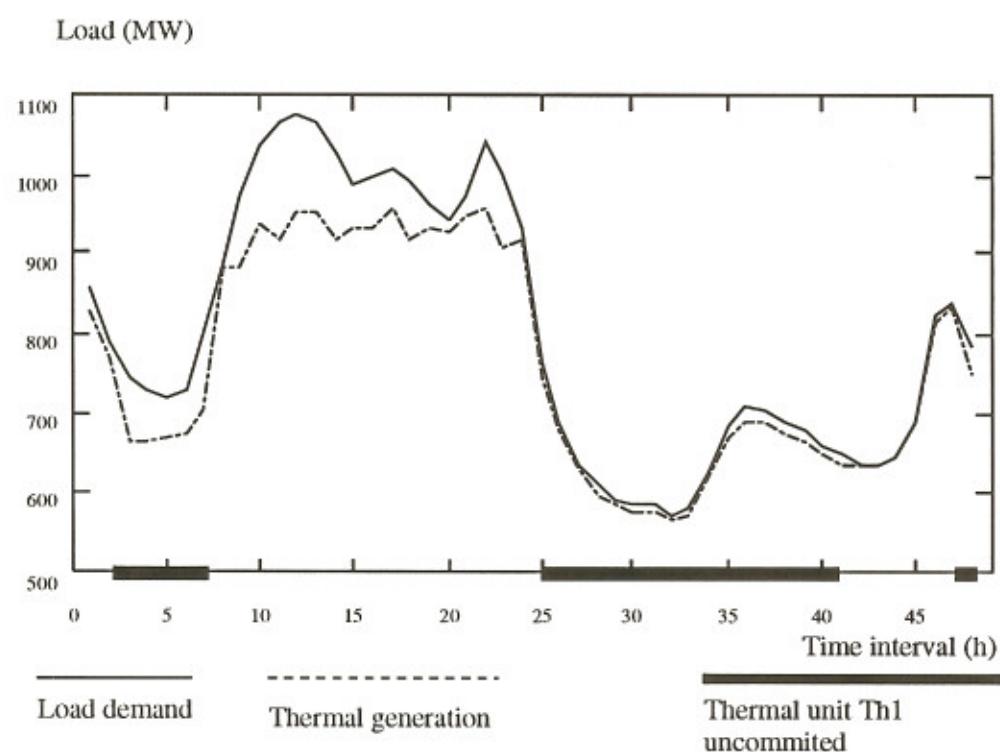
**B48x : LOAD COVERAGE**

Fig. 1 Atteintment of load at the optimal solution of case B48x.

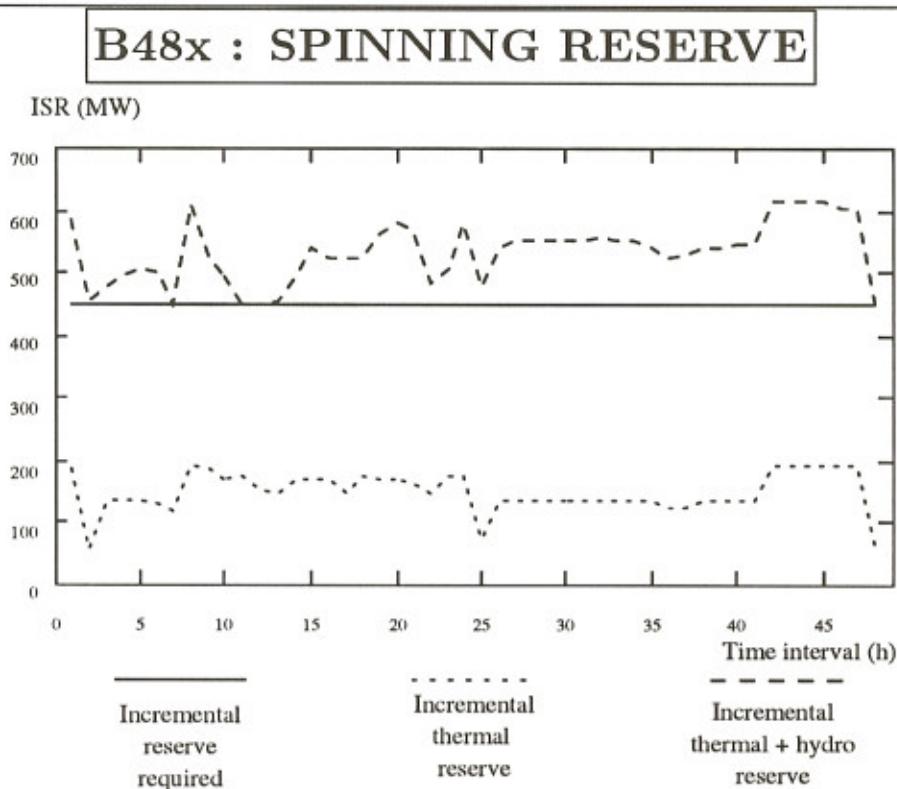


Fig. 2 Incremental reserve at the optimal solution of case B48x.

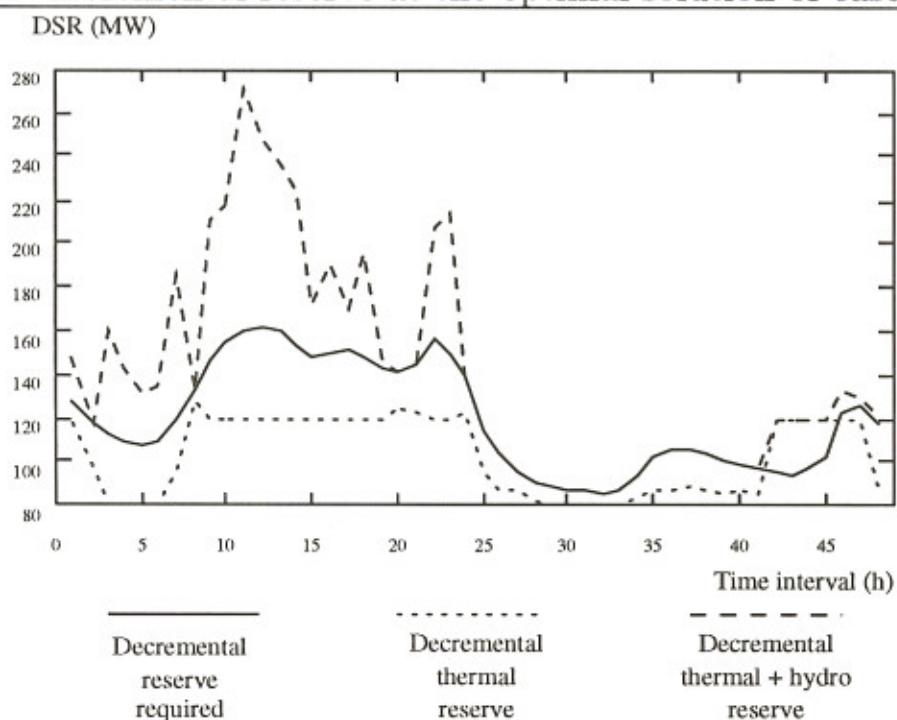


Fig. 3 Decremental reserve at the optimal solution of case B48x.


## CONCLUSIONS

- **Thermal equivalent network :**
  - \* Network flow model for the thermal generation and spinning reserve.
- **Coupled model :**
  - \* Optimization of generation costs and trans. losses.
  - \* HTTEN : Hydro, thermal and trans. network.
  - \* Coupling constraints : hydrogeneration arcs and spinning reserve.
  - \* Muti–interval hydrothermal dc OPF.
- **Successive linearizations :**
  - \* ~ one order of magnitude faster.
  - \* Deviation from the exact optimum : < 0.14%.
  - \* Hydrogeneration linearization error : < 2%.


## FURTHER DEVELOPMENTS

- **Practical interest of the model:**
  - \* Experiments with bigger power systems.
  - \* Coupled model vs. decoupled model with equivalent thermal network.
- **Extensions of the coupled model :**
  - \* Security constraints.
  - \* ac OPF.
  - \* Unit commitment.
- **Extensions of the solution methods :**
  - \* Extension of NOXCB to treat nonlinear constraints.

## B48x : TRANSMISSION LINES

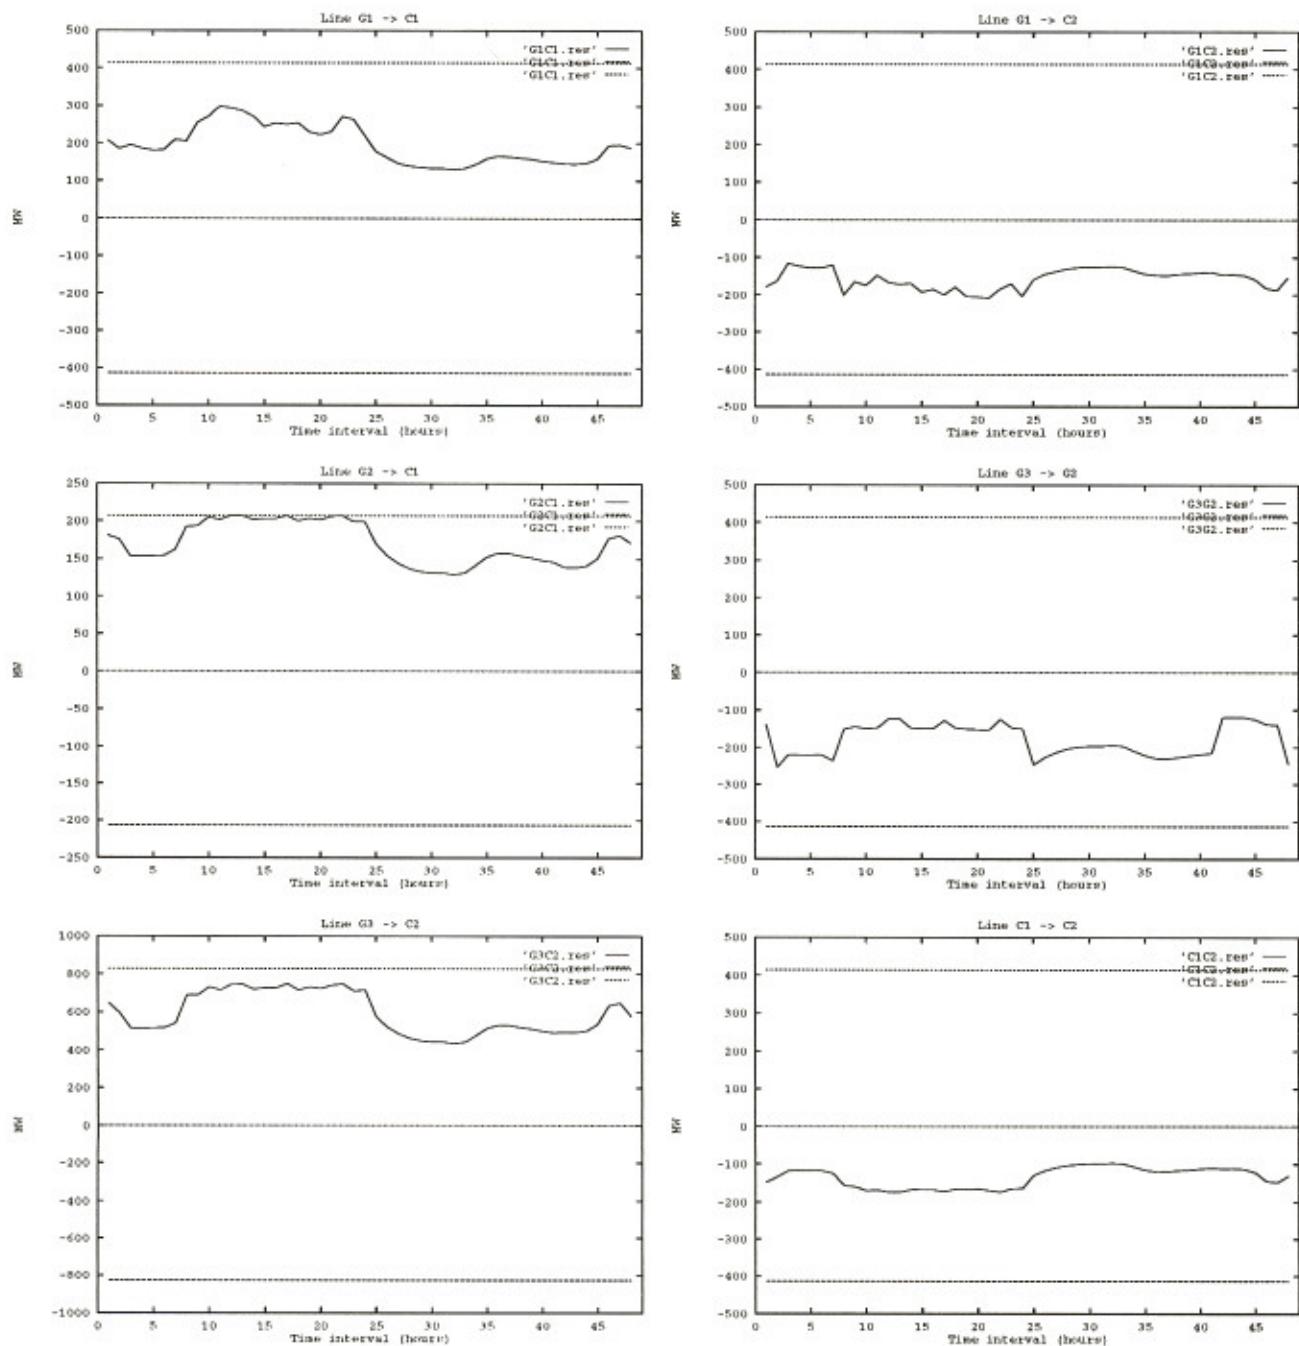


## B48x : THERMAL UNITS

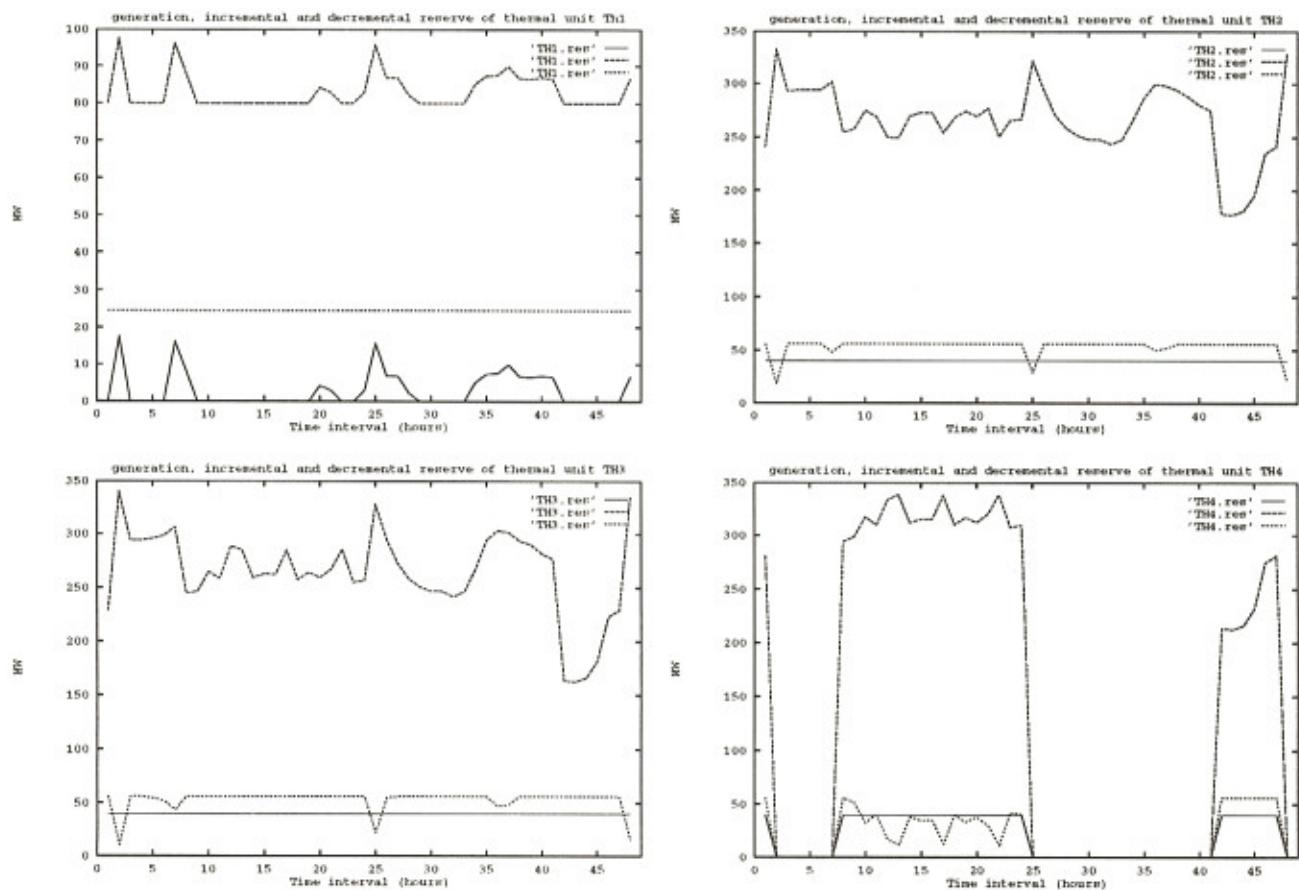


---


## ~B48x with constant efficiency

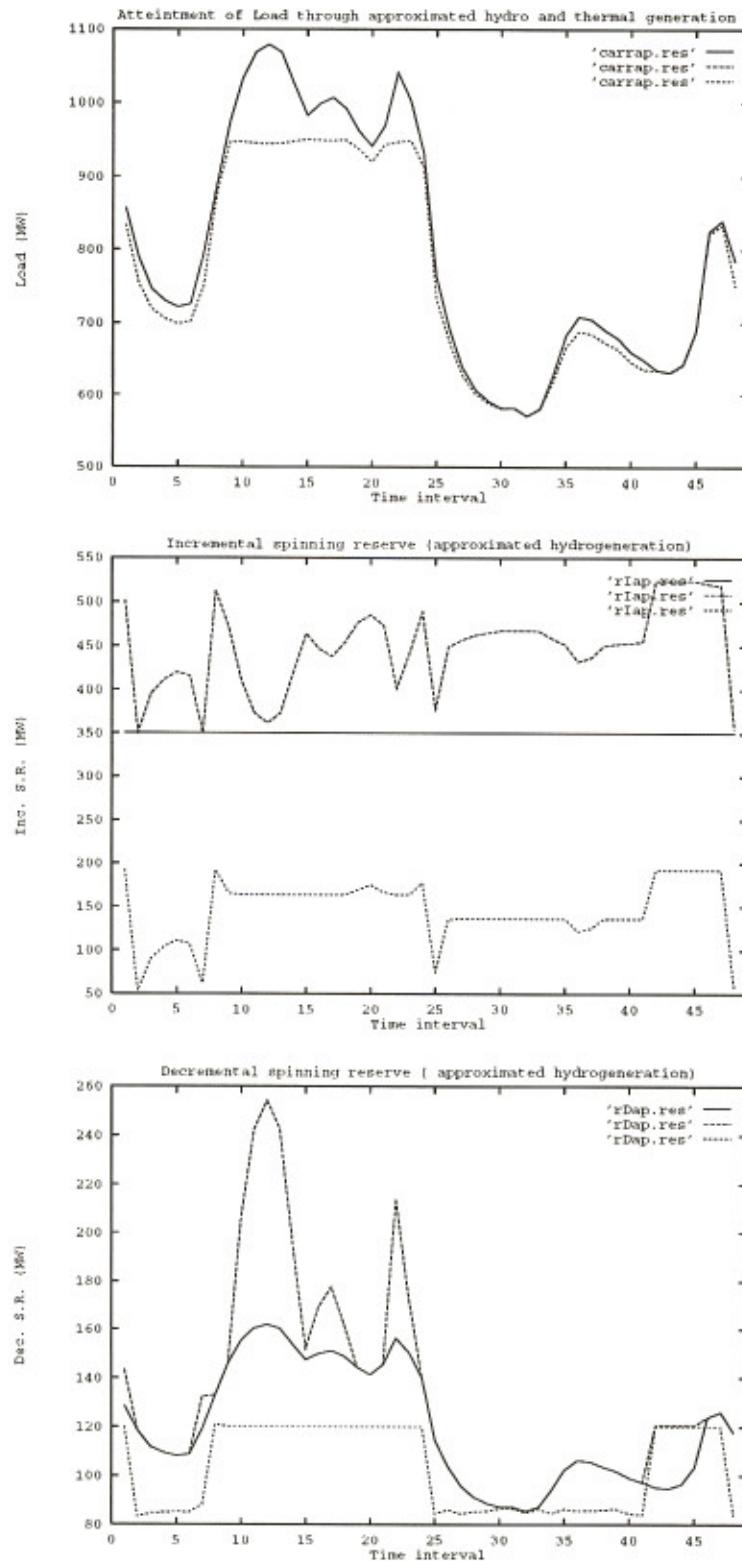


## ~B48x : transmission lines

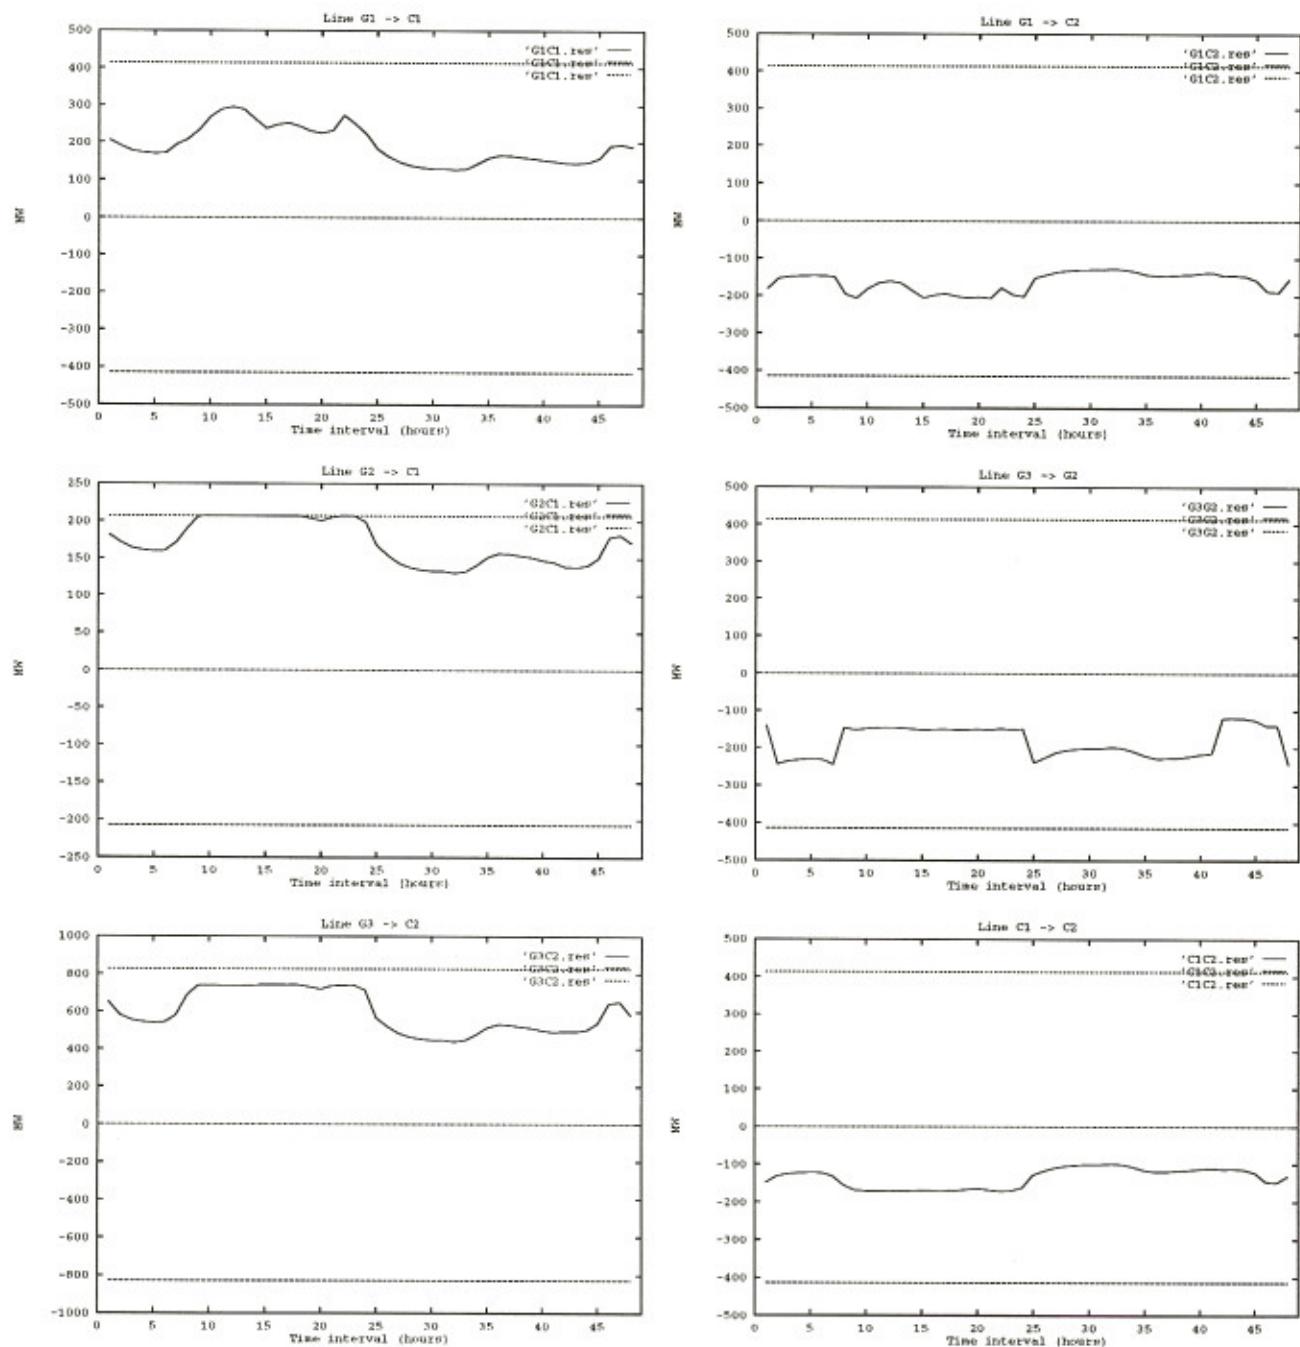

~ B48x : thermal units

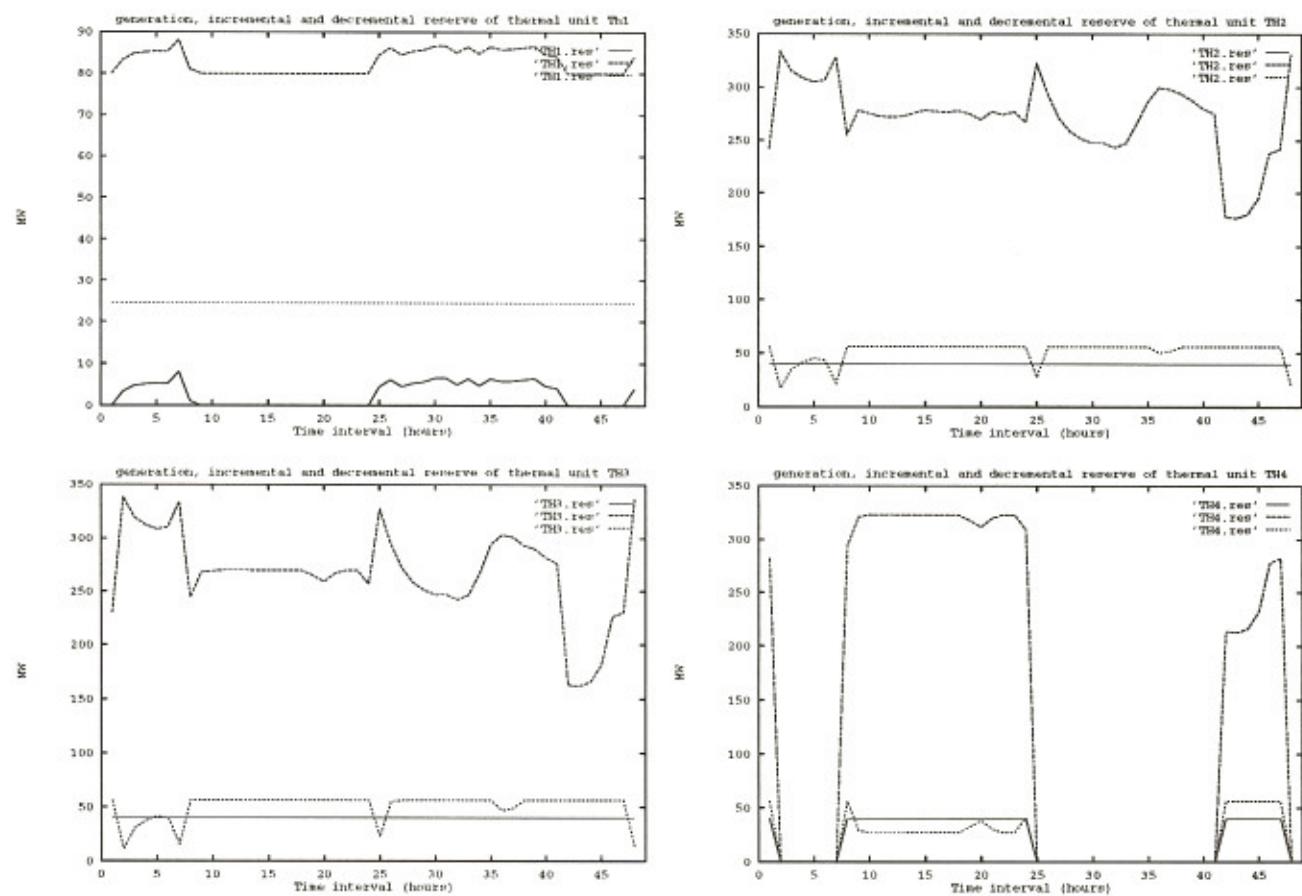

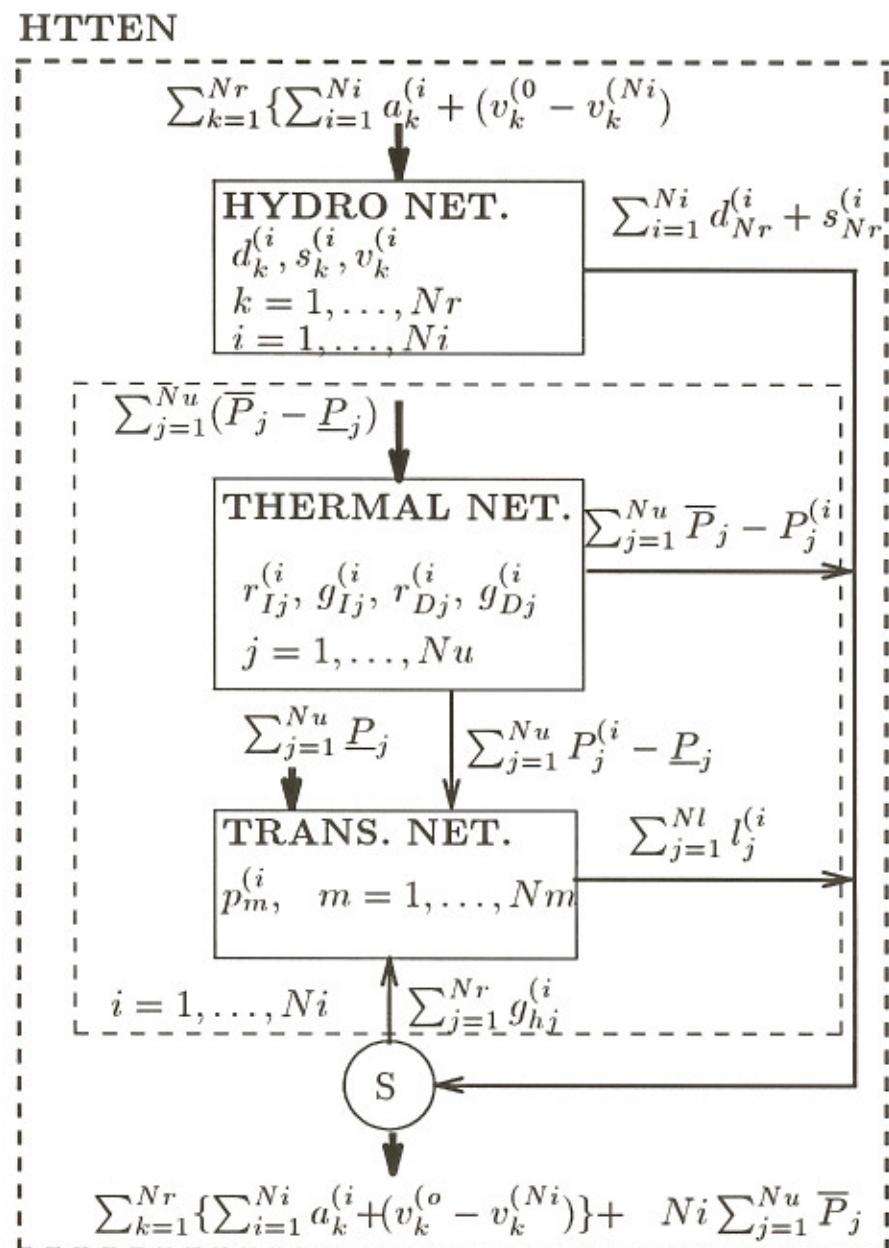

---

**Network model vs. non-network model**

- Network model :

$$\left. \begin{array}{l} r_{Ij} \leq \bar{r}_{Ij} \\ * \quad g_{Ij} \\ r_{Dj} \leq \bar{r}_{Dj} \\ * \quad g_{Dj} \end{array} \right\} \rightarrow \boxed{4 \text{ variables}}$$

$$* \quad r_{Ij} + g_{Ij} + r_{Dj} + g_{Dj} = \bar{P}_j - \underline{P}_j \rightarrow \boxed{1 \text{ network constraint}}$$

- Non network model :

$$\left. \begin{array}{l} r_{Ij} \leq \bar{r}_{Ij} \\ * \quad r_{Dj} \leq \bar{r}_{Dj} \\ * \quad P_j \end{array} \right\} \rightarrow \boxed{3 \text{ variables}}$$

$$\left. \begin{array}{l} r_{Ij} \leq \bar{P}_j - P_j \\ * \quad r_{Dj} \leq P_j - \underline{P}_j \end{array} \right\} \rightarrow \boxed{2 \text{ side constraint}}$$

---

**ITERATIVE SOLUTION METHOD**

---

**0 Initializations.**

- 0.1** Definition of the network equations of  $(\text{NNLC})^0$
- 0.2** Selection of the initial solution  $[x]^0$ ;  $k := 1$ .
- 0.3** Loose optimality tolerance :  $\epsilon_o = 0.01$
- 0.4** Maximum hydrogeneration error :  $\epsilon_L \approx 0.02$

**1 Main loop.**

- 1.5**  $k^{\text{th}}$  linearization :  $(\text{NNLC})^k$ .
    - Computation of  $\lambda^k$  at  $[x]^{k-1}$ .
    - Computation of  $[\bar{H}^{(i)}]^k$  at  $[x]^{k-1}$ .
    - Definition of the s.c. of  $(\text{NNLC})^k$ .
  - 1.6**  $k^{\text{th}}$  optimization :  $[x]^k \xleftarrow{\text{NOXCB}} (\text{NNLC})^k$ .
  - 1.7** If  $|[H_L^{(i)}]^k - [H^{(i)}]^k| < \epsilon_L L^{(i)}$ ,  $\forall i$  then
    - Tight optimality tolerance  $\epsilon_o := 10^{-6}$
    - Final optimization :  $x^* \xleftarrow{\text{NOXCB}} (\text{NNLC})^k$  from  $[x]^k$ .
    - If  $|[H_L^{(i)*}]^k - [H^{(i)*}]^k| < \epsilon_L L^{(i)}$ ,  $\forall i$  : END
    - $[x]^k := x^*$
  - 1.8**  $k := k + 1$ . go to **1.5** .
-